


1100IC Mounting Frame must be installed with the J-Box on the "UPHILL" side.

1104ICX/N Mounting Frame must be installed with the J-Box on the "DOWNHILL" side.

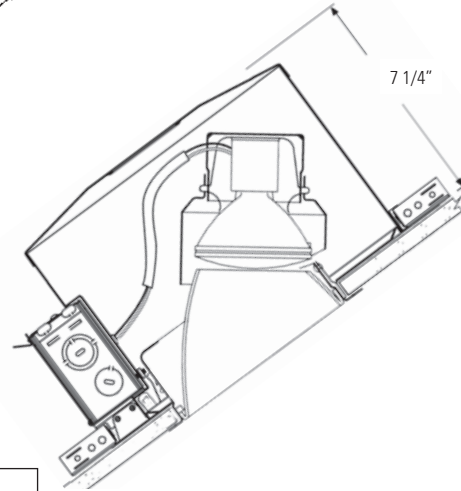

1133/1104ICX/N LyteSeal™ AirSeal® Insulated Ceiling

Complete Fixture consists of Reflector Trim & Frame-In Kit. Select each separately.

Reflector Trim		Frame-In Kit — See Individual Frame-In Kit Specification Sheets			
		Frame-In Kit	Installation Type	Lamping	Height
1133	Black Step Baffle	1100IC	IC	75W PAR30 (Short Neck)	7 5/16"
1133WH	Gloss White Step Baffle	1100AICM	AirSeal® IC		7 5/16"
1133GD	Specular Gold	1104ICX/N	AirSeal® IC		7 1/4"
1133CL	Specular Clear				
1133BK	Specular Black				

Features

- Housing:** Hydroformed aluminum, .040" thick; white trim flange.
- Aperture:** Conical aluminum step baffle, matte black or gloss white finish; or hydroformed aluminum cone, specular finish. For ceiling slopes 30° - 45° angle, 7/12 - 12/12 pitch. Baffle or cone must be removed for lamping.
- Lamp Housing:** Hydroformed aluminum, .040" thick; permits adjustment ±7° vertical for straight downlighting.
- Frame-In Kit:** See Frame-In Kit specification sheets for more details.

Options & Accessories

Extra Wide Flange Trim Ring: 1954 - 8 5/8" O.D.

Labels

UL (Suitable for Damp Locations), I.B.E.W.

Job Information	Type:
Job Name:	
Cat. No.:	
Lamp(s):	
Notes:	





Footcandles 2 1/2' Above the Floor

Fixture mounted on 5' x 5' centers (horizontally) in 15' x 30' room with sloped ceiling.

Room reflectances: 80% ceiling, 50% walls, 20% floor.

A = 75W PAR30 FL (Flood)

B = 75W PAR30 NFL (Narrow Flood)

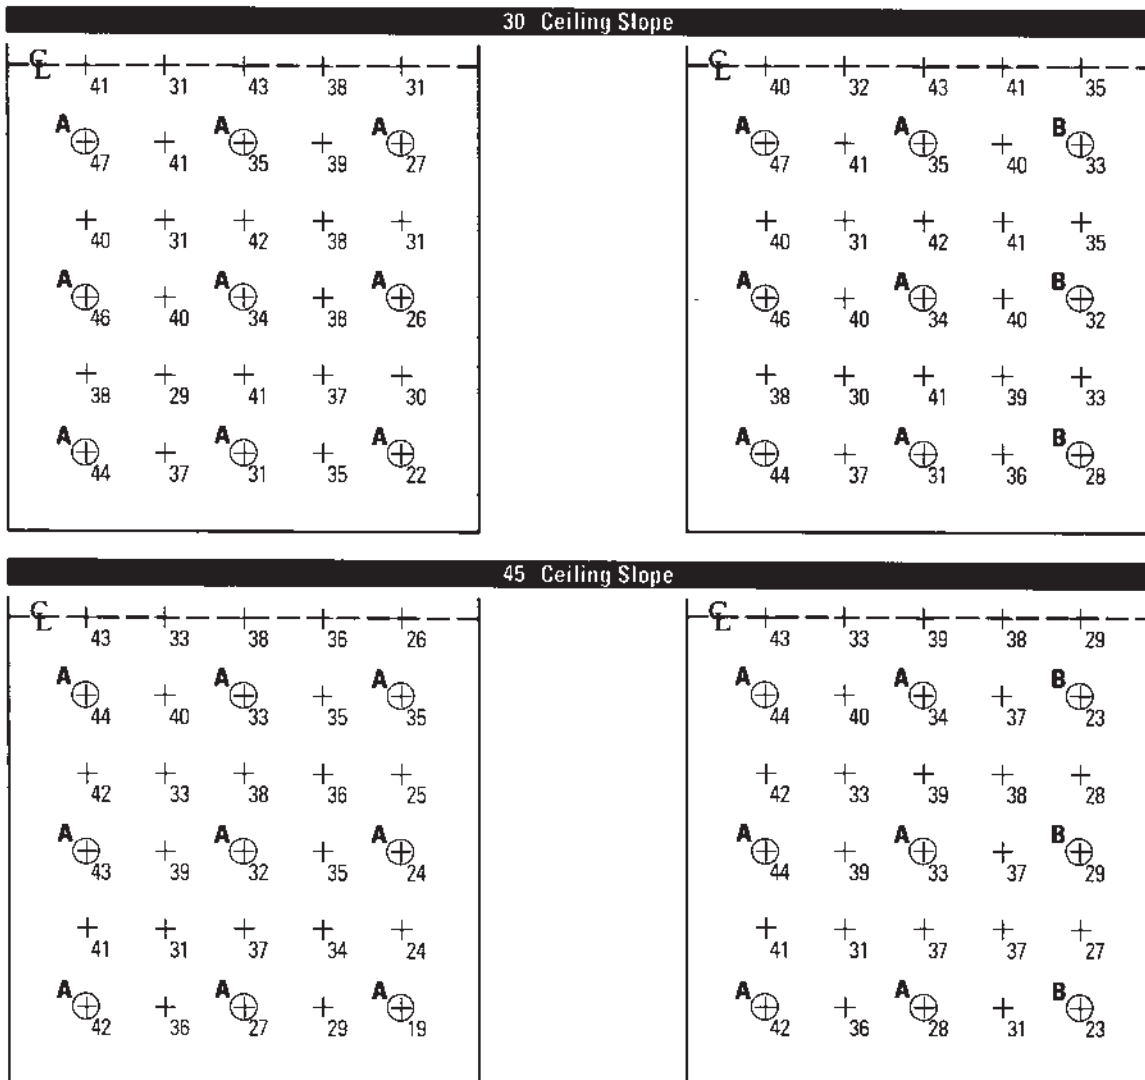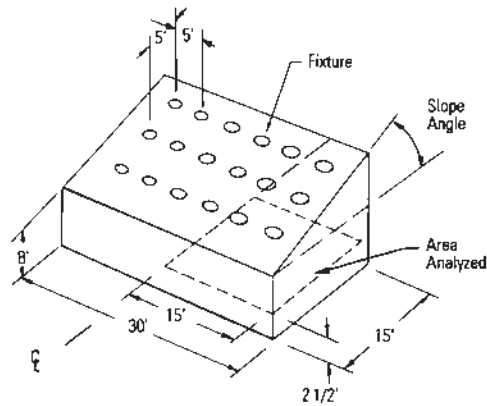

Data calculated with GENESYS using bare lamp photometrics. Fixture spacing exceeding 5' may cause lighting under lowest areas.

To convert lighting data for a lower wattage incandescent lamp of the **same type**, multiply the footcandle (or candlepower) values by the ratio of the lumens of the two lamps. The coefficients of utilization remain the same.

Job Information **Type:**

Lightolier a Genlyte company www.lightolier.com
 631 Airport Road, Fall River, MA 02720 • (508) 679-8131 • Fax (508) 674-4710
 We reserve the right to change details of design, materials and finish.
 © 2011 Genlyte Group LLC • G0711